


AMENDMENTS TO THE DRAWINGS

Proposed amendments to FIGS. 3-5 of the drawings are shown in the attached FIGS. 3-5.

● NORMAL-FLOW HEAT EXCHANGER ●
JAVIER A. VALENZUELA
07389-00007

Do not
enter,
JVC
1/1/64

FIG. 3

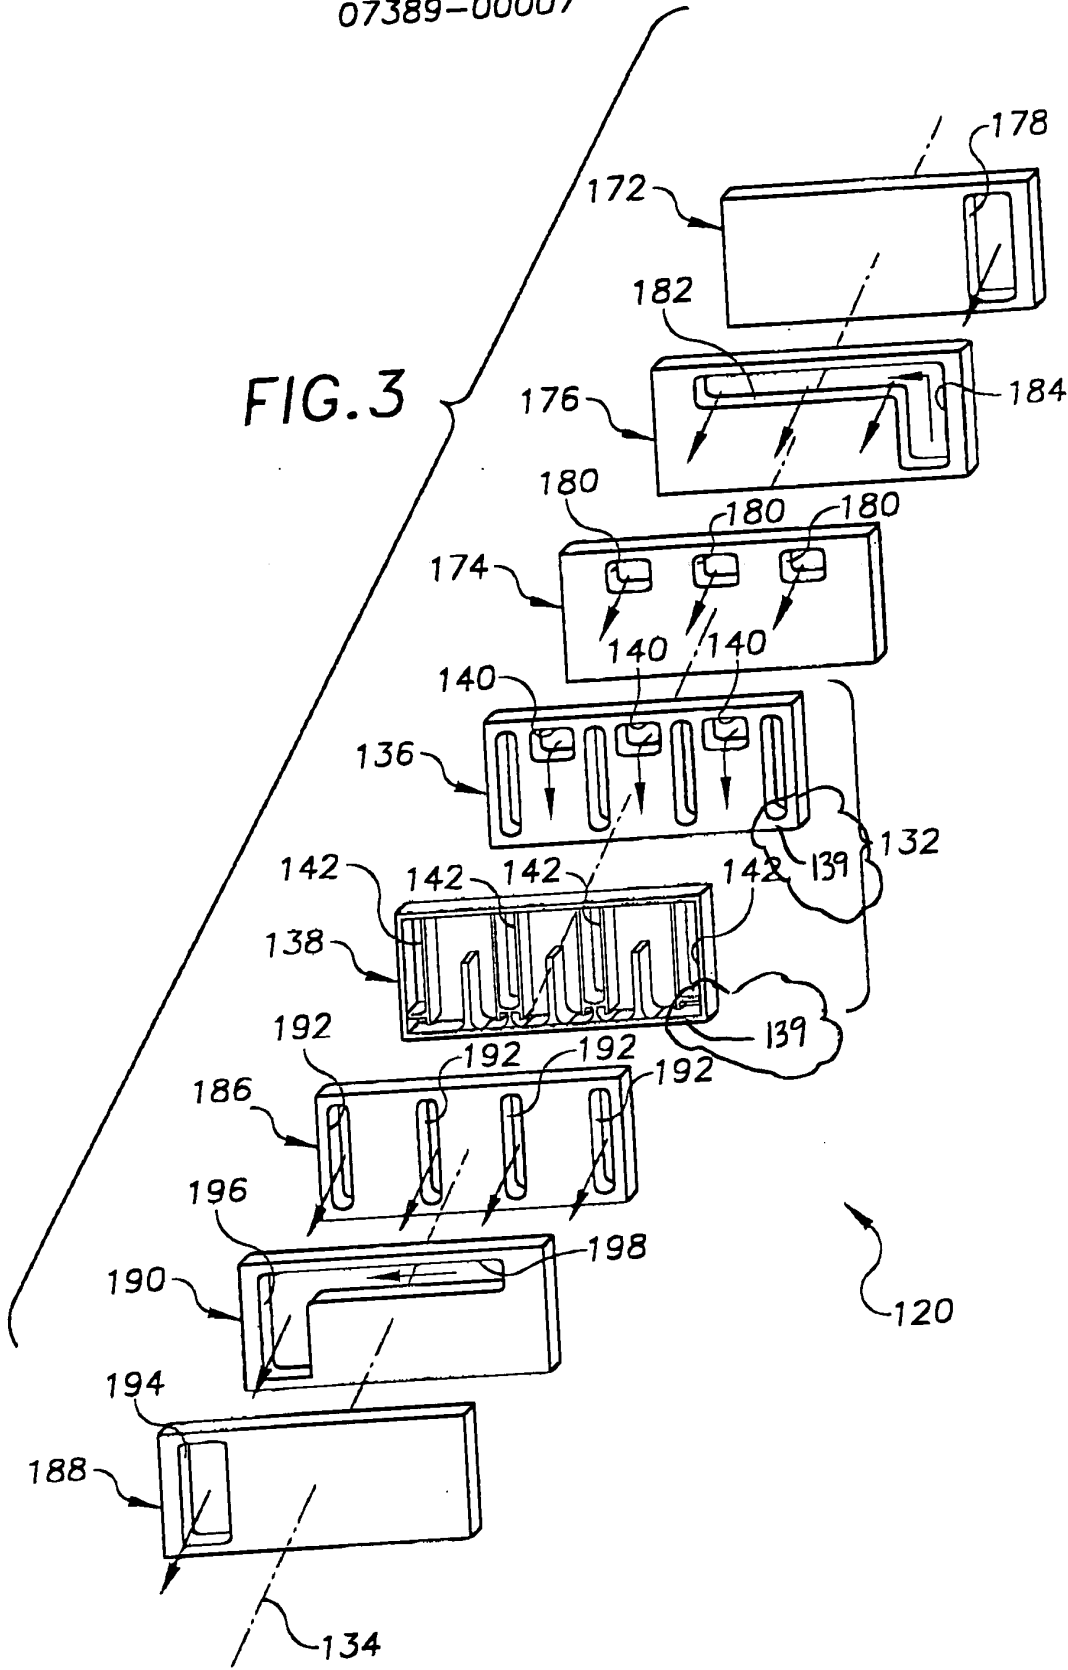


4/8

NORMAL-FLOW HEAT EXCHANGER

JAVIER A. VALENZUELA

07389-00007

*Don't
enter.
JVC
1/11/04*

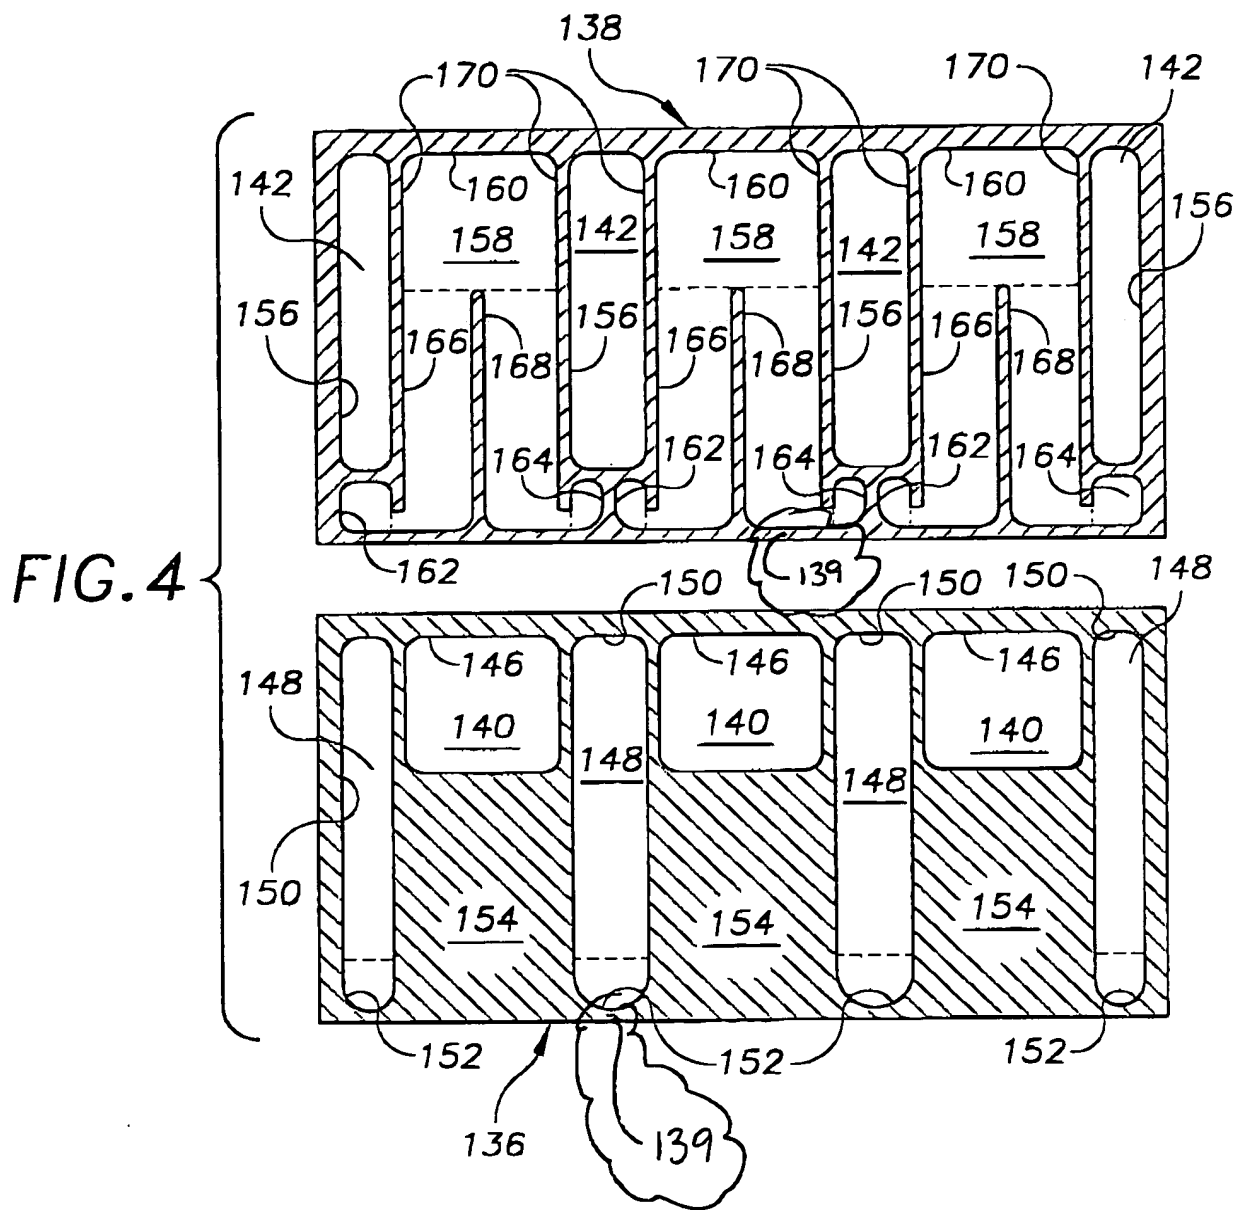

5/8


NORMAL-FLOW HEAT EXCHANGER

JAVIER A. VALENZUELA

07389-00007

Do not
enter,
JVC
1-11-04

FIG. 5

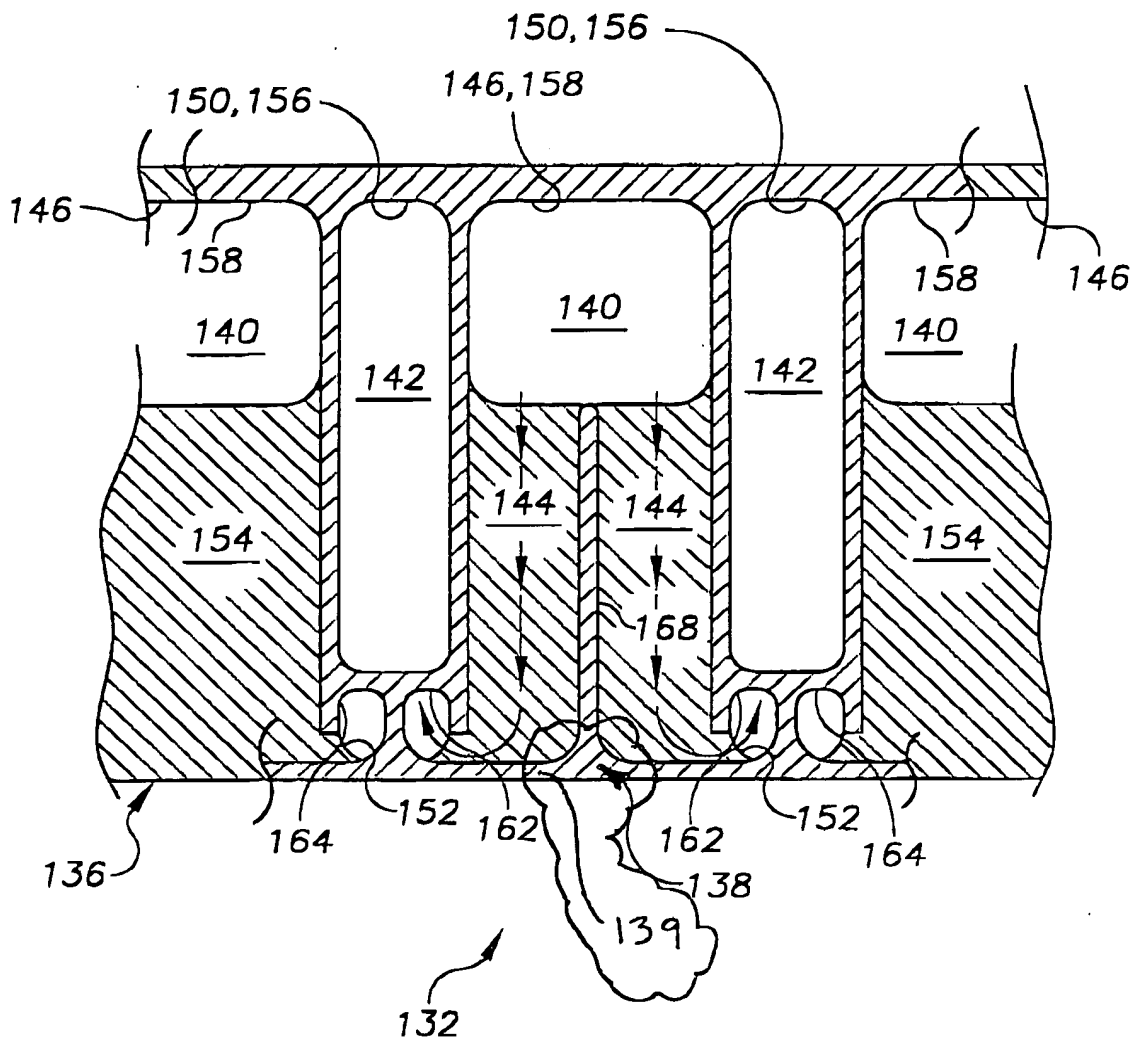

6/8

NORMAL-FLOW HEAT EXCHANGER
JAVIER A. VALENZUELA
 07389-00007

Do not
 enter,
 JVC
 1-11-04

FIG. 6

